

Product Evaluation Report

Report No.: FL-14935.2

Date: February 5, 2015

| Product Category | Sub Category | Manufacturer | Product Name |
|------------------|--------------------------|--|---|
| Exterior Doors | Exterior Door Components | ODL/Western Reflections 215 East Roosevelt, Ave. Zeeland, MI 49464 Phone - 616.748.5437 | ODL / Western Reflections "Impact Resistant" Severe Weather® Doorglass Assembly for Glazing up to a 3'0 x 8'0 Single Panel |

Scope: Product Evaluation report issued by R W Building Consultants, Inc. & Lyndon F. Schmidt, P.E. (System ID # 1998) for ODL/Western Reflections, based on Rule Chapter No. 61G20-3, Method 1D of the State of Florida Product Approval, Department of Community Affairs - Florida Building Commission.


RW Building Consultants and Lyndon F. Schmidt, P.E. do not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

Limitations:

1. This product has been evaluated and is in compliance with the 5th Edition (2014) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. When used in areas requiring wind borne debris protection this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Section 1609.1.2.2.
3. This product is approved for use as a substitute doorglass assembly in conjunction with a glazed steel or fiberglass side hinged swing door and/or fixed sidelite possessing a comparable current Florida Statewide product approval.
4. The design pressure (DP) rating shall be the lesser of the DP rating shown on sheet 1 of Drawing No. FL-14935.2 or the DP rating shown in the glazed steel or fiberglass side hinged swing door or fixed sidelite approval being used.
5. The door panel and lite opening size shall not exceed the sizes shown in Drawing No. FL-14935.2 or in the glazed steel or fiberglass side hinged swing door or fixed sidelite approval being used.
6. This product has been tested in the door and/or sidelite panels as specified on sheets 5, 6 & 7 of Drawing No. FL-14935.2. Substitution into a similar product may be approved for use by the local Authority Having Jurisdiction. In all cases, the glazed steel or fiberglass door and/or sidelite used must possess a comparable current Florida Statewide product approval.

Supporting Documents:

- | | | | |
|--|---|--|---|
| <p>1. Test Report No. TEL 01310304 TEL 01310320 TEL 01310197 TEL 01310446</p> | <p>Test Standard ASTM E330-02, ASTM E1886-05/1996-06 ASTM E330-02, ASTM E1886-05/1996-06 ASTM E330-02, ASTM E1886-05/1996-06 ASTM E330-02, ASTM E1886-05/1996-06</p> | <p>Testing Laboratory Testing Evaluation Lab., Inc. Testing Evaluation Lab., Inc. Testing Evaluation Lab., Inc. Testing Evaluation Lab., Inc.</p> | <p>Signed by Lyndon F. Schmidt, P.E. Lyndon F. Schmidt, P.E. Lyndon F. Schmidt, P.E. Lyndon F. Schmidt, P.E.</p> |
| <p>2. Drawing No. No. FL-14935.2</p> | <p>Prepared by RW Building Consultants, Inc. (CA #9813)</p> | | <p>Signed & Sealed by Lyndon F. Schmidt, P.E.</p> |
| <p>3. Miami-Dade NOA No. 14-0423.17</p> | <p>Materials Testing Saflex PVB Interlayer (Eastman Chemical Company)</p> | | |
| <p>4. Quality Assurance Certificate of Participation issued by National Accreditation and Management Institute, certifying that ODL/Western Reflections is manufacturing products within a quality assurance program that complies with ISO/IEC 17020 and Guide 53.</p> | | | |

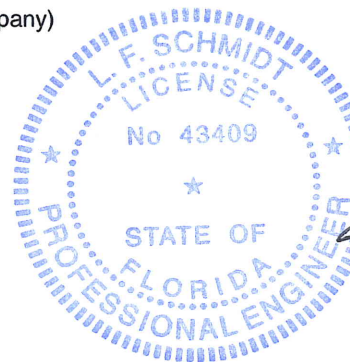

Lyndon F. Schmidt, P.E.
FL PE No. 43409
2/5/2015